

CAMERA-READY LOGOTYPE — UL SIGNALING LISTING MARKS FOR CANADA AND THE U.S.

These Marks are registered by Underwriters Laboratories Inc.

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED

SIGNALING



LISTED


SIGNALING



LISTED

The minimum height of the registered trademark symbol ® shall be 3/64 of an inch. When the overall diameter of the UL Listing Mark for signaling is less than 3/8 of an inch, the trademark symbol may be omitted if it is not legible to the naked eye. The font for all letter forms is Helvetica Condensed Black except for the trademark symbol which is Helvetica Condensed Medium. No other fonts are acceptable. Regulatory information adjacent to the Mark will be set in Helvetica Condensed Bold.

RELATIVE DESIGN & PROPORTIONS OF THE UL SIGNALING LISTING MARKS FOR CANADA AND THE U.S.

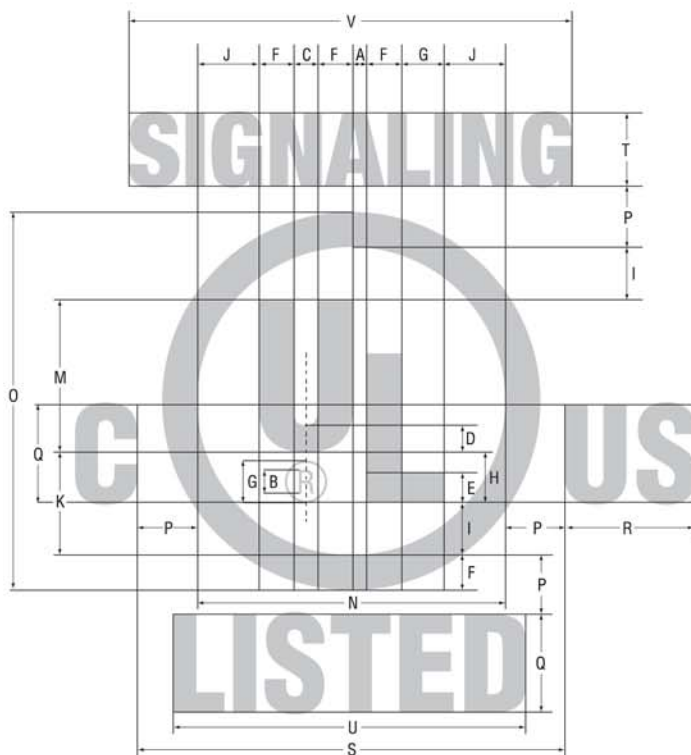

KEY TO DIMENSIONS

UL Mark

A	8 units
B	13 units
C	14 units
D	15 units
E	17 units
F	20 units
G	24 units
H	29 units
I	30 units
J	35 units
K	59 units
L	85 units
M	87 units
N	176 units
O	216 units

"C" and "US"

P	34 units
Q	56 units
R	75 units
S	245 units

"SIGNALING" and "LISTED"

T	42 units
U	201 units
V	254 units

